

Evaluation of long-term operation of combined system for heating the building and preparation of domestic hot water

Dawid Taler^{1,*}, Rafał Pitry¹, and Jan Taler¹

¹Cracow University of Technology, Faculty of Environmental Engineering, Warszawska 24, 30-001 Krakow, Poland

²Thermo-Instal Company, Bałandy 4D/8, 32-600 Oświęcim, Poland

Abstract. The paper presents, the results of research on the operation and energy efficiency of a 186 kW gas-fired condensing boiler operating in a hybrid heat source system. The boiler co-operates with an 81.1 kW (electric) brine-to-water compressor heat pump, a 27.4 kW air-to-water heat pump and 6 flat solar collectors. A local, built-in, hybrid heat source is located in a public building and is intended to satisfy the building needs. The study was conducted over a period of 1 year – from 1 September 2014 to 31 August 2015. The gas-fired boiler operates in the heating buffer system all year round. The boiler performance is characterized both in the winter and in the summer season, in terms of the amount of heat produced and the heating power. The calculations results of the heat generation efficiency obtained in the measuring period are also presented

1 Introduction

In recent years, fossil fuel shortage and environmental pollution have resulted in the rapid use of renewable energy sources. Hybrid systems of supplying residential buildings with electricity, heat and domestic hot water that combine photovoltaic cells, solar collectors, ground and air heat pumps and gas boilers quickly develop. Combined heating, cooling and power systems including domestic hot water preparation have been the subject of numerous publications in recent years. The feasibility and affordability of hybrid photovoltaic-thermal (PV-T) collectors coupled with thermal or electrical solar heating and cooling systems (absorption chillers or heat pumps) were studied in [1], also using thermal energy storage. The proposed systems were analyzed in 4-5 person households with a 100 m² floor area and 50 m² rooftop area suitable for installation of solar collectors. Ten selected locations with different climatic conditions in Europe were studied. A least-cost investment methodology that optimizes the hybrid power-residential heating system, including thermal energy storage, was developed in [2]. Different configurations were considered: gas boiler-electric resistance heater, heat pump-gas boiler, and heat pump-electric resistance heater. The hybrid ground heat exchangers of ground-coupled heat pump systems using vertical, as well as horizontal heat exchangers, were studied in [3]. The optimum load ratio of horizontal to vertical ground

* Corresponding author: dtaler@pk.edu.pl

heat exchangers was found. The performance of a heat pump with hybrid heat source including solar and air energy using different refrigerants was simulated in [4]. Based on a lumped parameter model of the heat pump, the characteristics of the heat pump as the power consumption and coefficient of performance (COP) were established for three refrigerants R22, R134a, R744, and CO₂. There are no significant differences in the performance of the heat pump used three different refrigerants. The heat pump with CO₂ as the working fluid has a low COP, but it has a good low-temperature performance. The efficiency of new power sources (co-generation, tri-generation systems, fuel cells, photovoltaic systems) can be enhanced using heat pipe heat exchangers and solid sorption heat pumps [5]. In this paper, the results of experimental investigations of a hybrid heating and domestic hot water preparation system in a public building are presented. The wide variety of micro and mini heat sources currently offered by manufacturers makes it possible to design solutions not only with a single energy-generating device but also with more complex hybrid heat source systems including two or even more heat generators. Due to technical requirements, e.g., high supply temperature, or economic limitations, e.g., low cost of purchase, renewable heat sources, such as heat pumps or solar collectors, often need a traditional heat generator such as a gas-fired boiler. Each stage of development of this type of solutions – investment, design, construction or operation – is highly complex, and the comprehensive approach to the problem should not be based on a one-off, fragmentary and out-of-context analysis of the device, but on a comprehensive analysis of all aspects of the hybrid solution operation. The considerations presented herein are limited to the gas-fired boiler assessment and significance in a hybrid heat source in relation to the amount of generated thermal energy, the share of thermal output, working time and heat generation efficiency. Previous analyses of hybrid source systems for heating and preparing domestic hot water were carried out using various computer simulation programs. In this paper, the actual experimental results of one-year operation of hybrid source installations were presented.

2 Characteristics of investigated hybrid heat source

The aim of the analysis is a gas-fired boiler operating in a local hybrid heat source system located in the modern building of the Headquarters of the State Fire Service in *Oświęcim, Matopolska* province (voivodeship). The building and the installations were put in use in September 2011. The headquarters building is supplied with thermal energy by a local hybrid heat source, the center of which is a buffer tank. The hydronic system flowchart is shown in Fig. 1. The heat source includes:

- **KG**: a floor-standing Vitocrossal 200 CM2 186 kW gas-fired condensing boiler with a compact modulating Matrix burner,
- **PC1**: a Thermalia 90 81.1 kW (B0W35), 109.3 kW (W10W35) brine-to-water compression (ground source) heat pump made by the Hoval company, with a lower heat source in the form of 18-meter deep vertical brine probes,
- **PC2**: a Belaria 27 27.4 kW (A2W35) air-to-water compression heat pump made by the Hoval company,
- **KS**: Vitosol 100 SV1 flat solar collectors made by the Viessmann company, with the gross surface area of 6 x 2.51 m².

The heat source operates for the heating, ventilation and domestic hot water preparation. Due to the different temperature characteristics, the heat-receiving systems are divided into two groups. The first group comprises low-temperature heating circuits (60/45°C) with low-temperature parameters (NP) 1-3 (marked in Fig. 1 as R1). The total power of the receivers is 129.2 kW. The second group includes heating circuits with numbers 4-7 and domestic hot water installation. This group is characterized by high-temperature parameters (WP) (marked in Fig. 1 as R2), with the total power of 231.7 kW and a design temperature of 80/60°C.

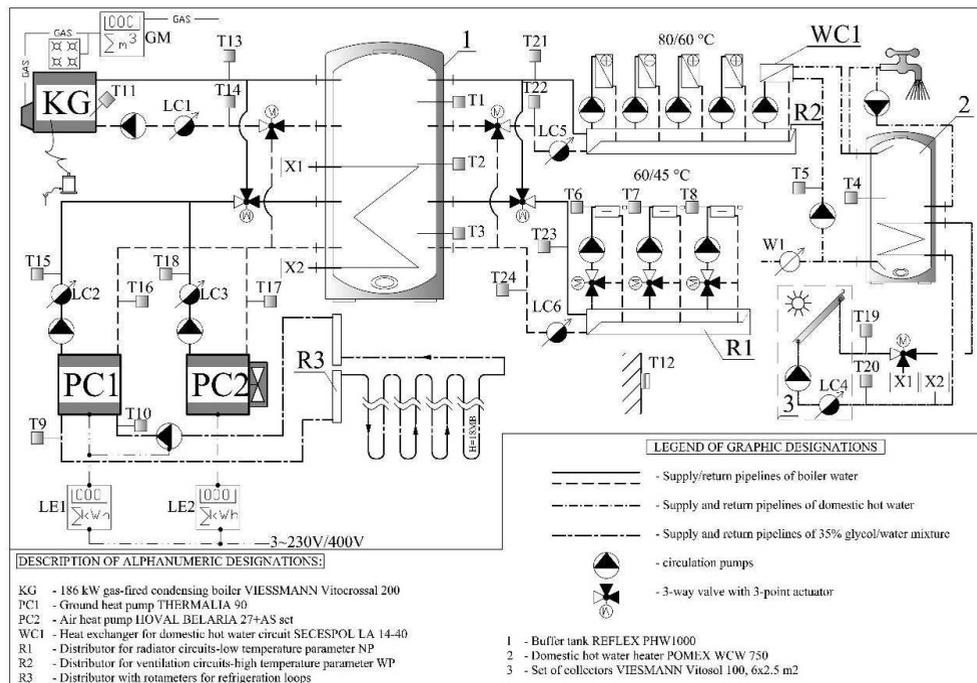


Fig. 1. Technological flowchart of the hybrid heat source including the measuring elements. Basic marking adopted in the measuring system: LC1÷LC6 – heat meters, LE1, LE2 – electricity meters, W1 – domestic hot water meter, GM – bellows gas meter, T1÷T22 – temperature transducers, the other markings are in the figure

The building of the Headquarters of the Local Government Fire Station is located in climatic zone III. The facility is composed of three units performing different functions. The building total cubic volume is 18432.15 m³. The research was conducted from 1 September 2014 to 31 August 2015.

3 Test facility and measurements results

A new system of control, measurement, and recording of the entire heat source necessary operating parameters was designed for the needs of the research works. The measuring system flowchart is presented in Fig. 1. The technological system was equipped with water flow and heat meters, meters of the electric power network parameters and a *masterPLC*-type [6] data acquisition system made by the Altel company. Combustion analysis was performed to assess the gas-fired boiler combustion quality. The technological system and the measuring system are controlled by a master PLC controller.

4 Thermal energy production

During the measuring year (Fig. 2) the most significant amounts of thermal energy were generated by gas-fired boiler KG – 470.1 GJ/year (51.11%), brine-to-water heat pump PC1 – 395.7 GJ/year (43.02%), air-to-water heat pump PC2 – 35.8 GJ/year (3.89%), and solar collectors KS – 18.2 GJ/year (1.98%). The amount of thermal energy produced in the heating season is many times larger compared to the heat generated in the summer season: 878.2 GJ and 41.6 GJ, respectively. For this reason, the percentage share of energy generated by individual devices in the heating season (Fig. 3) is close to the annual value. In the summer

season, the opposite is the case (Fig. 4) – the most significant amounts of thermal energy were generated by heat pump PC2 – 25.8 GJ/summer season (62.02%), solar collectors KS – 10.8 GJ/summer season (25.96%) and gas-fired boiler KG – 5.0 GJ/summer season (12.02%). During the summer, heat pump PC1 did not operate.

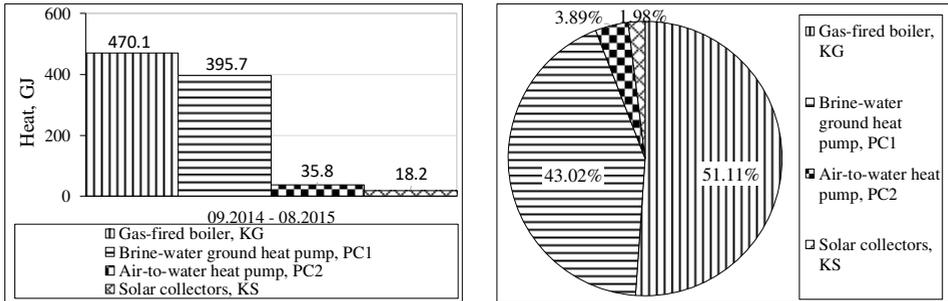


Fig. 2. Results of measurements of thermal energy production by individual generating devices in the entire measuring year by amount and percentage

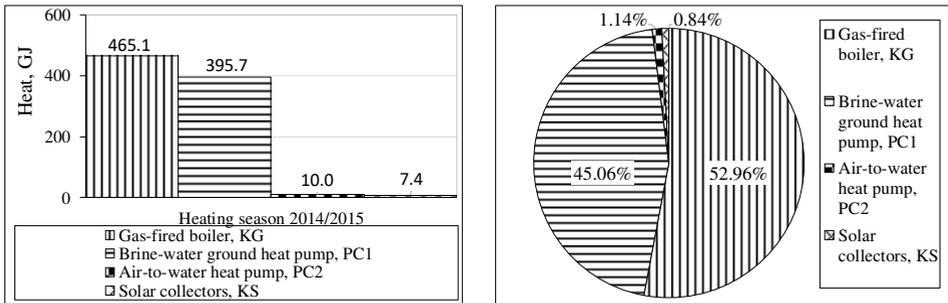


Fig. 3. Results of measurements of thermal energy production by individual generating devices in the heating season by amount and percentage

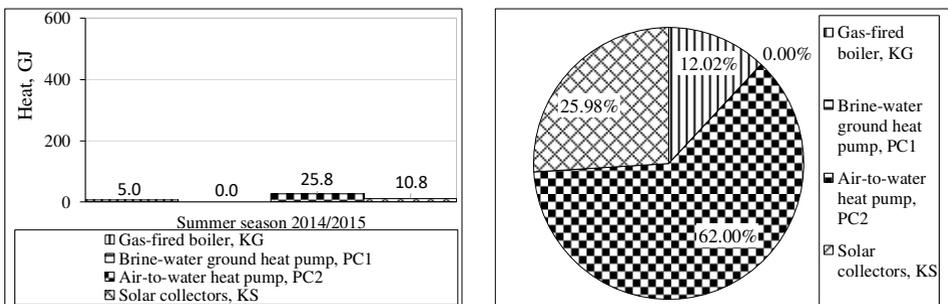


Fig. 4. Results of measurements of thermal energy production by individual generating devices in the summer season by amount and percentage

5 Planning of diagnostic experiments

During the heating season, the gas-fired boiler operated with an average thermal power of 119.1 kW with a standard deviation of 42.6 kW. For the summer season, the thermal power and the standard deviation values were 95.3 kW and 47.3 kW, respectively, which in the

whole year under consideration gives the boiler operation with the average thermal power of 118.8 kW with a standard deviation of 42.8 kW. The typical values for the winter (heating) and the summer seasons and the entire measuring year are 157.0 kW, 131.0 kW, and 157.0kW, respectively. The thermal power typical values are close to the gas-fired boiler maximum value of 186 kW. The charts are illustrating monthly thermal power values (Fig. 5 and Fig. 6) point to the gas-fired boiler cyclic operation ensuring an appropriate level of temperature in the buffer tank. Thermal power is supplied to the buffer tank in a wide range from 0 kW to 375 kW, which momentarily exceeds the boiler maximum power. This is the effect of the system being cooled down and the occurrence of a difference between the water temperature at the outlet and the inlet of the boiler higher than design temperature difference equal to 20K. Table 1 presents the monthly and annual characteristics of the gas-fired boiler output.

Table 1. Results of measurements of the gas-fired boiler (KG) thermal output

Period of analysis	Maximum output, kW	Mean output, kW	Period of analysis	Maximum output, kW	Mean output, kW
September 2014	152.0	84.0	May 2015	208.0	112.8
October 2014	279.0	85.5	June 2015	203.0	123.4
November 2014	247.0	87.3	July 2015	157.0	83.7
December 2014	329.0	123.8	August 2015	156.0	85.0
January 2015	343.0	122.4			
February 2015	375.0	120.6	Entire heating season	375.0	119.1
March 2015	319.0	153.9	Summer season	203.0	95.3
April 2015	341.0	149.7	Year	375.0	118.8

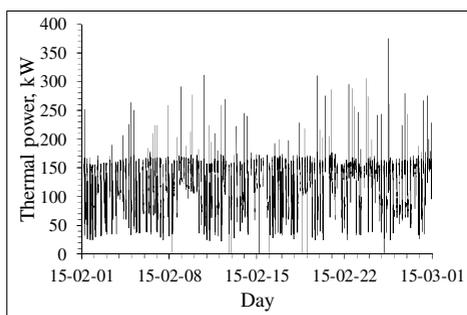


Fig. 5. Results of the gas-fired boiler (KG) thermalpower measurements in February 2015

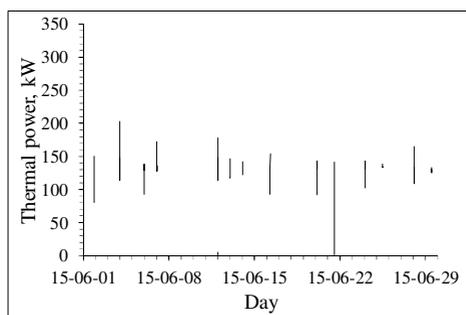


Fig. 6. Results of the gas-fired boiler (KG) thermalpower measurements in June 2015

6 Working time characteristics

The activation of each energy-generating device is related to transferring thermal energy to the buffer tank. An exception is the activation of the gas-fired boiler burner where thermal energy cannot be transferred unless the boiler circulation pump is activated (Fig. 1, where the pump is marked as P2). The longest working time is found for the brine-to-water heat pump PC1 – 1875.1 hours, 1103.6 of which was operation at the first degree of the power output and 771.5 hours – at the second. The next longest working times are for the solar collectors – 1341.4 hours, the gas-fired boiler (KG) – 1085.6 and the air-to-water heat pump

PC2 – 321.1 hours. As presented in Table 2, the annual working time of an individual device does not depend on the device installed power. The gas-fired boiler (KG) overall working time during the heating season – 1072.2 h – is almost 75 times longer than the working time measured in the summer season – 14.4 h. The average duration of the gas-fired boiler operation cycle in the entire year is 0.8 h.

The shortest – 0.1 h – was recorded in June and July 2015, and the longest – 1.5 h – in January 2015. 1411 starts were measured when the boiler joined in to operate within the heating system. The calculation results indicate that during the year the boiler operated using the phenomenon of water vapor condensation in flue gases for 283.5 hours, which makes up 26.1% of the entire operation during the year. The boiler total working time per month ranged from 3.1 to 226.3 hours. Table 2 below presents the calculation results obtained based on the working time of the gas-fired boiler.

Table 2. Results of measurements and calculations of the gas-fired boiler (KG) working time

Analysis period	Number of boiler starts	Total working time (number of boiler pump starts)	The average length of boiler operation	Operating time of the boiler with a percentage share of water steam condensation	
				<i>H</i>	%
	-	<i>H</i>	<i>h</i>	<i>H</i>	%
Sept 2014	18	3.2	0.2	1.8	54.4
Oct 2014	130	83.9	0.6	15.9	19.0
Nov 2014	288	157.8	0.5	46.8	29.6
Dec 2014	164	203.2	1.2	22.9	11.3
Jan 2015	150	226.3	1.5	104.1	46.0
Feb 2015	137	195.7	1.4	21.1	10.8
Mar 2015	193	107.6	0.6	58.3	54.2
Apr 2015	171	79.6	0.5	44.2	55.6
May 2015	65	16.1	0.2	7.8	48.6
Jun 2015	40	3.1	0.1	2.2	72.8
Jul 2015	39	4.7	0.1	2.2	47.0
Aug 2015	16	4.3	0.3	2.0	45.9
Heating season	1296	1071.2	0.8	233.6	21.8
Summer season	115	14.4	0.1	49.9	-
One year period	1411	1085.6	0.8	283.5	26.1

The shortest – 0.1 h – was recorded in June and July 2015, and the longest – 1.5 h – in January 2015. 1411 starts were measured when the boiler joined in to operate within the heating system. The calculation results indicate that during the year the boiler operated using the phenomenon of water vapor condensation in flue gases for 283.5 hours, which makes up 26.1% of the entire operation during the year. The boiler total working time per month ranged from 3.1 to 226.3 hours.

7 Heat generation efficiency characteristics

The efficiency of thermal energy generation by the gas-fired boiler (KG) during the measuring period was calculated as the ratio between the thermal energy measured by heat meter LC1 and the measured amount of natural gas-fired in the boiler multiplied by the gas lower heating value:

$$\varepsilon_{WY,KG} = \frac{E_{LC1}}{V_{KG} \cdot W_{d_g}} \quad (1)$$

where :

- E_{LC1} – thermal energy generated by the gas-fired boiler (KG) and recorded by heat meter LC1 in GJ,
- V_{KG} – the boiler recorded natural gas consumption – gas meter (GM) reading reduced by gas consumption for cooking in m³,
- W_{d_g} – a lower heating value the gas fuel in GJ/m³.

Based on the measuring data obtained in the measuring year under analysis, the heat generation efficiency calculated for the gas-fired boiler (KG) is $\varepsilon_{WY,KG}=0.96$ per year, for the heating season – $\varepsilon_{WY,KG}=0.96$ and for the summer season – $\varepsilon_{WY,KG}=0.60$. The arithmetic mean calculated from the monthly efficiency values is 0.82, and is therefore not comparable to the annual results of calculation of generation efficiency – $\varepsilon_{WY,KG}$. An analysis of the measurement data indicates that the monthly heat generation efficiency was the highest in December 2014 – $\varepsilon_{WY,KG} = 0.99$. The lowest efficiency value was found for the device in September 2015 – $\varepsilon_{WY,KG} = 0.49$. A rising trend can be observed for the changes in efficiency from October to April. The boiler momentary efficiency for the burner minimum and maximum power was 98.4% and 97.6%, respectively.

8 Conclusions

Based on the measurements and calculations carried out, the following conclusions can be drawn:

- The amount of thermal energy produced by a given energy-generating device is not proportional to its installed power but depends substantially on the device working time within the system. The installed power of the gas-fired boiler KG is 186 kW, but its percentage share of the annual thermal energy production is 51.11%. For the 81.1 kW heat pump PC1, the percentage share of the overall annual thermal energy generation is 43.02%. These results are also confirmed by the simulation of the hydronic system operation using the Polysun program.
- Energy-generating devices operate cyclically. For this reason, the recorded values of power generated due to the operation of the devices varied in a wide range, including values exceeding the device rated power. This phenomenon is related to the fact that the system is considerably cooled at the start-up of the energy-generating device.
- The gas-fired boiler (KG) operation characteristics in the winter and the summer season differ substantially. In the winter (heating) season, the boiler is activated fast and dynamically with hot water transferred into the buffer system. In the summer season, long periods occur, even up to a few days, when water remains cool in the boiler water region.
- The heat generation efficiency of the gas-fired boiler (KG) averaged per year is $\varepsilon_{WY,KG}=0.96$. In the heating season, the efficiency value is almost equal to the annual average, but it drops significantly in the summer season to $\varepsilon_{WY,KG}=0.60$.
- In a hybrid system, heat generation efficiency is strongly dependent on specific system parameters. Such relations should be identified, e.g., by computer simulations in advance and can be a starting point for design and optimization of complex hybrid systems in which conventional and renewable heat sources are used.

References

1. Ramos A., Chatzopoulou M. A., Guarracino I., Freeman J., Markides Ch. N., Hybrid photovoltaic-thermal solar systems for combined heating, cooling and power provision in the urban environment, *Energy Conversion, and Management*, **150**, pp. 838-850, (2017)
2. Heinen S., Burke D., O'Malley M., Electricity, gas, heat integration via residential hybrid heating technologies – An investment model assessment, *Energy*, **109**, pp. 906-919, (2016)
3. Wei K., Li W., Li J., Wang Y., Zhang L., Study on a design method for hybrid ground heat exchangers of ground-coupled heat pump system, *Int. J. of Refrigeration*, **76**, pp. 394-405, (2017)
4. Li S., Li S., Zhang X. Comparison analysis of different refrigerants in solar-air hybrid heat source heat pump water heater, *Int. J. of Refrigeration*, **57**, pp. 138-146, (2015)
5. Vasiliev L.L., Kakaç S. Eds. *Heat Pipes and Solid Sorption Transformations: Fundamentals and Practical Applications*, CRC Press, Taylor & Francis Group, Boca Raton, Florida, USA, (2013)